



KEY NOTES:

- P01

SEE RISER DIAGRAM ON DRAWING E00.1 FOR FEEDER SIZE.
- P02

3#10+1#10G IN 3/4"Ø.
- P03

PROVIDE AND INSTALL (2) 3ØA, 3-POLE BREAKERS IN EXISTING SPACES 13,15,17,19,21,23 TO SERVE NEW PUMPS P-1 AND P-2.
PROVIDE AND INSTALL (2) 2ØA, 1-POLE BREAKER IN EXISTING SPACES 14,16 TO SERVE (3) NEW CP-1 AND ROOFTOP LIGHT AND RECEPTACLE. NEW BREAKERS SHALL MATCH EXISTING TYPE INCLUDING AIC RATING.

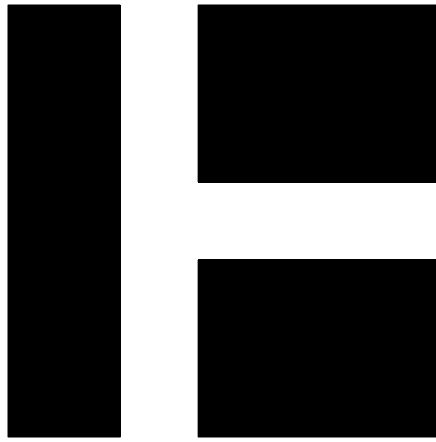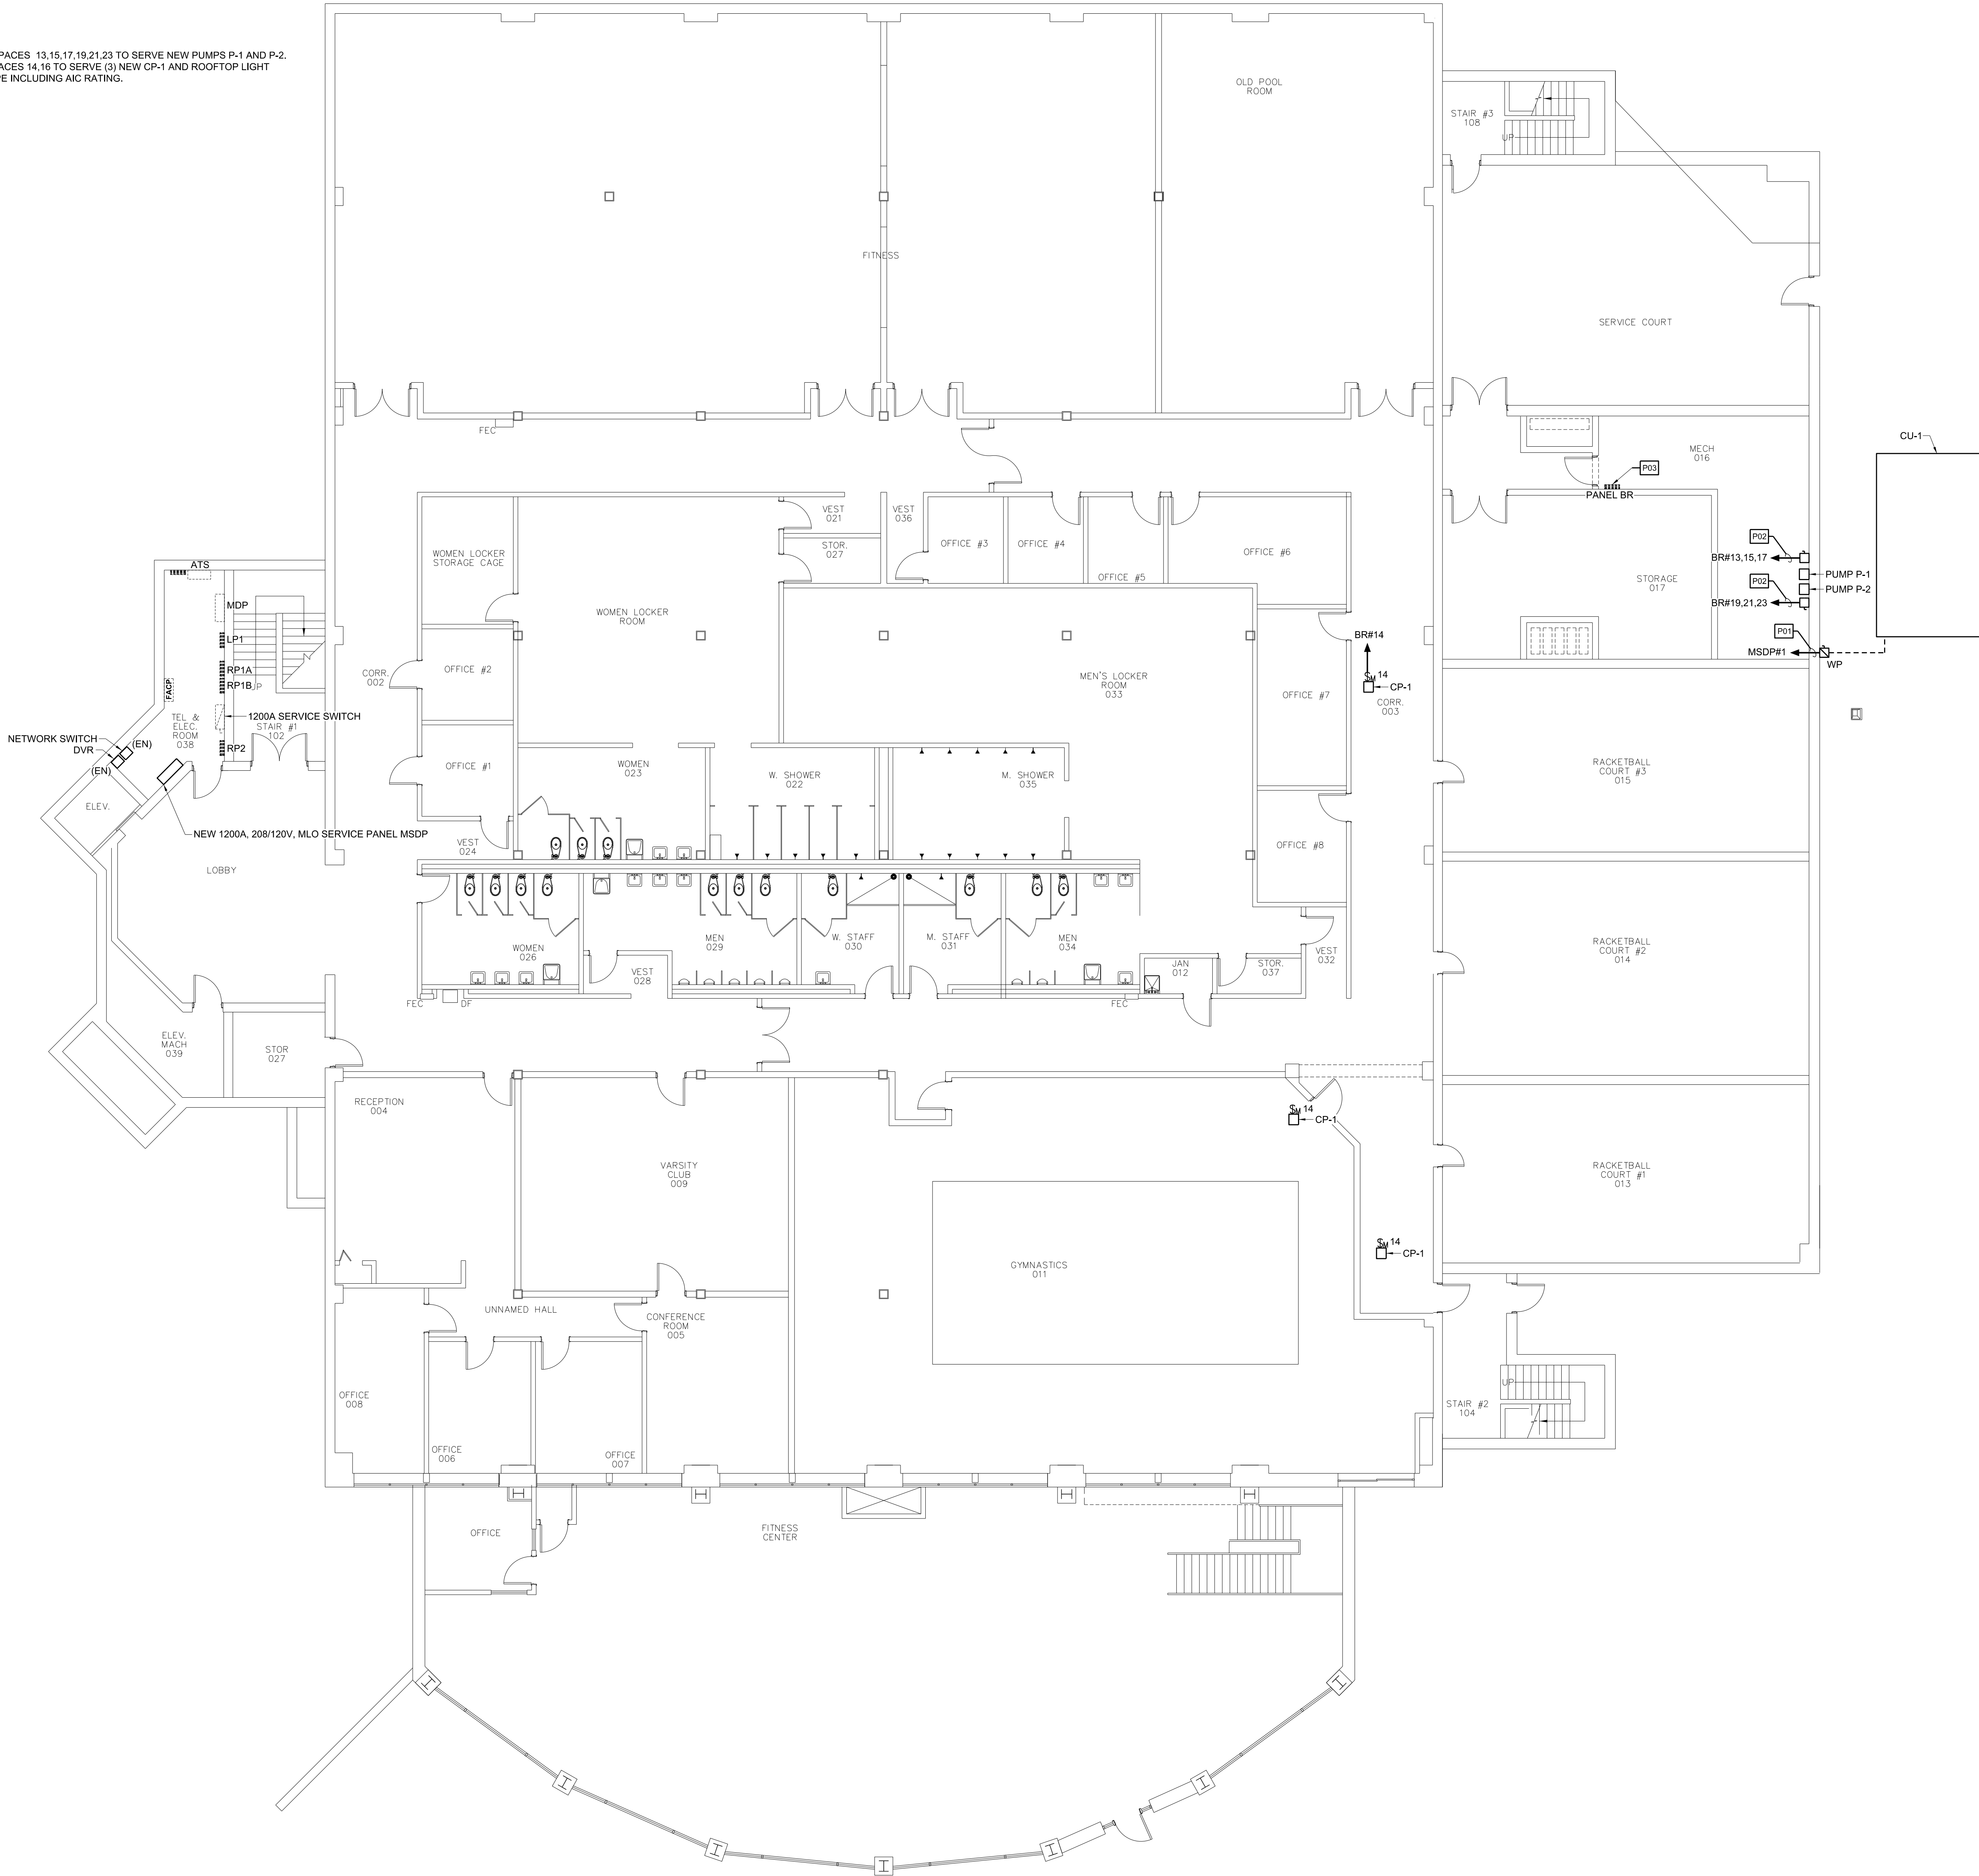

HARRIMAN

AUBURN PORTLAND PORTSMOUTH BOSTON

SAINT ANSELM COLLEGE
LOWER LEVEL COOLING
CARR CENTER

MANCHESTER, NEW HAMPSHIRE	
Harriman Project No.	17343
Key Plan	Proj North

Issues and Revisions	
Date	Description
03-23-17	DESIGN DEVELOPMENT
04-18-17	100% REVIEW

PRELIMINARY
NOT FOR
CONSTRUCTION

Drawing Scales	0 4' 8' 12'
----------------	-------------

PA / PE: JWP	© 2017
Drawn By: APG	Harriman Associates

LOWER LEVEL
PLAN
POWER AND SYSTEMS

E20.1